
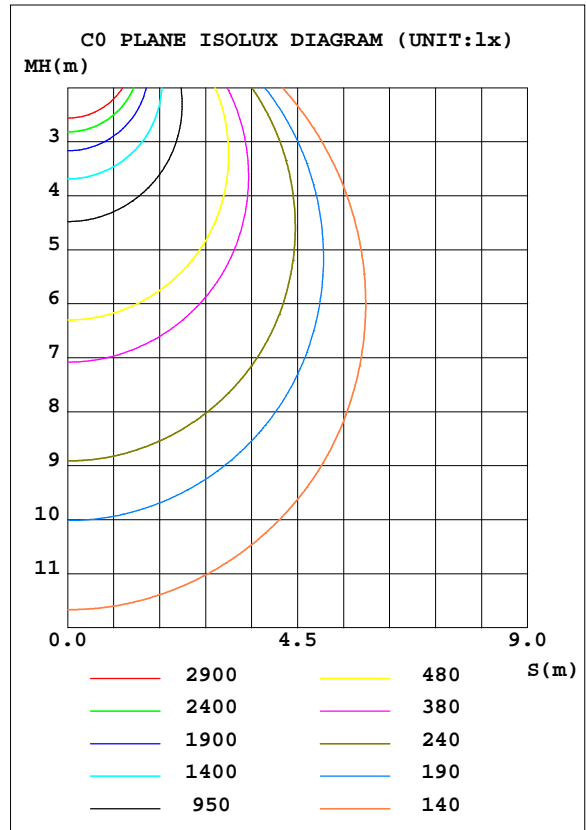


**LUMINAIRE PHOTOMETRIC TEST REPORT**

NAME:	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:
MFR.:	SUR.:	PROTECTION ANGLE:

DATA OF LAMP		PHOTOMETRIC DATA Eff: 180.84 lm/W			
MODEL		I <sub>max</sub> (cd)	18981	S/MH(C0/180)	1.30
NOMINAL POWER(W)	300	LOR(%)	311.2	S/MH(C90/270)	1.26
RATED VOLTAGE(V)	220	TOTAL FLUX(lm)	54377	η UP, DN(C0-180)	2.4,148.5
NOMINAL FLUX(lm)	17476.1	CIE CLASS	DIRECT	η UP, DN(C180-360)	2.5,157.7
LAMPS INSIDE	1	η up(%)	5.0	CIBSE SHR NOM	1.25
TEST VOLTAGE(V)	220.6	η down(%)	306.2	CIBSE SHR MAX	1.35

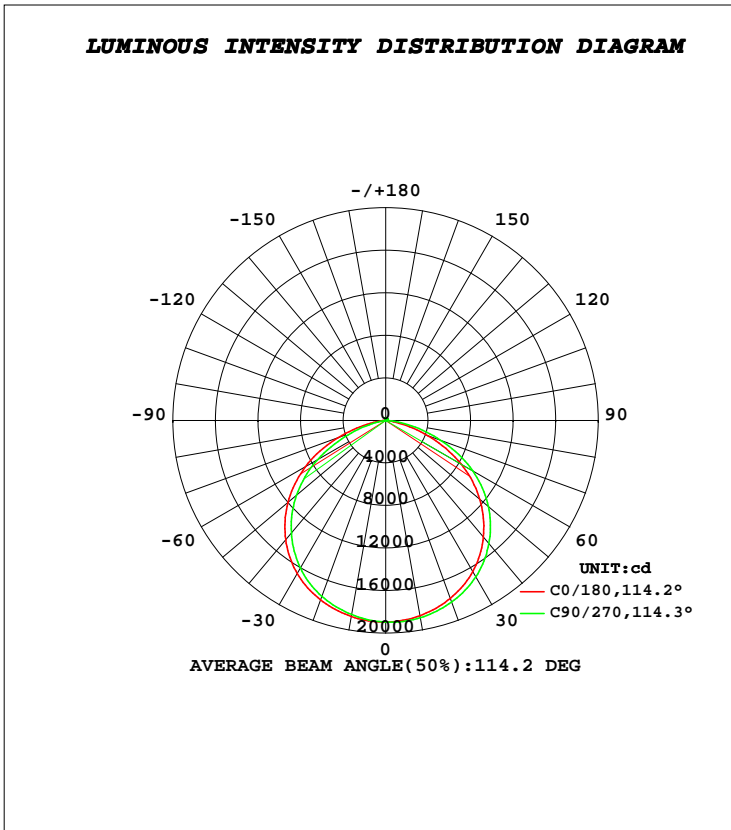

**C Range: 0 - 360DEG**  
**C Interval: 90.0DEG**  
**Test Speed: HIGH**  
**Temperature: 25DEG**  
**Operators: DAMIN**  
**Test Date: 2025-01-03**

**γ Range: 0 - 180DEG**  
**γ Interval: 1.0DEG**  
**Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.269**  
**Humidity: 65.0%**  
**Test Distance: 7.000m [K=1.0000]**  
**Remarks:**

ZONAL FLUX DIAGRAM

ZONAL FLUX DIAGRAM:

$\gamma$	C0	C90	C180	C270				$\gamma$	$\Phi$ zone	$\Phi$ total	%lum, lamp
10	1871	1852	1864	1883				0- 10	1796	1796	3.3,10.3
20	1795	1759	1780	1817				10- 20	5180	6976	12.8,39.9
30	1664	1604	1640	1697				20- 30	7964	14939	27.5,85.5
40	1463	1380	1430	1511				30- 40	9737	24677	45.4,141
50	1200	1096	1157	1260				40- 50	10172	34849	64.1,199
60	872.6	741.4	817.1	945.0				50- 60	9093	43942	80.8,251
70	479.9	343.5	423.7	555.0				60- 70	6420	50362	92.6,288
80	118.4	37.04	75.30	181.0				70- 80	2803	53165	97.8,304
90	6.362	6.973	7.495	6.992				80- 90	344.5	53510	98.4,306
100	8.285	9.053	9.580	8.749				90-100	86.07	53596	98.6,307
110	10.49	11.26	11.81	10.95				100-110	105.9	53702	98.8,307
120	12.63	13.35	13.93	13.08				110-120	121.0	53823	99,308
130	14.66	15.39	15.91	15.08				120-130	127.7	53950	99.2,309
140	16.83	17.60	18.03	17.16				130-140	126.1	54077	99.4,309
150	19.23	20.00	20.25	19.42				140-150	116.3	54193	99.7,310
160	21.72	22.38	22.48	21.73				150-160	96.48	54289	99.8,311
170	23.60	24.03	24.06	23.60				160-170	64.99	54354	100,311
180	24.43	24.56	24.59	24.47				170-180	23.06	54377	100,311
DEG	LUMINOUS INTENSITY:×10cd								UNIT: lm		


C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature:25DEG  
 Operators:DAMIN  
 Test Date:2025-01-03

$\gamma$  Range: 0 - 180DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System:EVERFINE GO-2000B\_V1 SYSTEM V2.0.269  
 Humidity:65.0%  
 Test Distance:7.000m [K=1.0000]  
 Remarks:

CU AND LUMINAIRE BUDGETARY ESTIMATE DIAGRAM

NAME:	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:
MFR.:	SUR.:	PROTECTION ANGLE:

$\rho_{cc}$	80%			70%			50%			30%			10%			0
$\rho_w$	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
$\rho_{fc}$	20%			20%			20%			20%			20%			0
<b>RCR</b>	<b>RCR:Room Cavity Ratio</b>						<b>Coefficients of Utilization(CU)</b>									
0.0	3.69	3.69	3.69	3.60	3.60	3.60	3.43	3.43	3.43	3.27	3.27	3.27	3.13	3.13	3.13	3.06
1.0	3.26	3.13	3.02	3.18	3.07	2.97	3.04	2.95	2.86	2.91	2.84	2.77	2.79	2.73	2.68	2.61
2.0	2.85	2.65	2.47	2.79	2.60	2.44	2.67	2.51	2.38	2.56	2.43	2.32	2.46	2.35	2.26	2.19
3.0	2.50	2.26	2.06	2.45	2.22	2.04	2.35	2.16	2.00	2.26	2.10	1.96	2.18	2.04	1.92	1.85
4.0	2.22	1.95	1.75	2.17	1.93	1.73	2.09	1.87	1.70	2.01	1.83	1.68	1.94	1.78	1.65	1.58
5.0	1.98	1.71	1.50	1.94	1.69	1.49	1.87	1.65	1.47	1.81	1.61	1.45	1.74	1.57	1.43	1.36
6.0	1.78	1.51	1.31	1.75	1.49	1.30	1.69	1.46	1.29	1.63	1.43	1.27	1.58	1.40	1.26	1.19
7.0	1.61	1.34	1.16	1.59	1.33	1.15	1.53	1.30	1.14	1.49	1.28	1.13	1.44	1.26	1.11	1.05
8.0	1.47	1.21	1.03	1.45	1.20	1.02	1.40	1.18	1.01	1.36	1.16	1.01	1.32	1.14	.99	.94
9.0	1.35	1.10	.92	1.33	1.09	.92	1.29	1.07	.91	1.25	1.05	.91	1.22	1.03	.90	.84
10.0	1.24	.99	.84	1.23	.99	.83	1.19	.98	.83	1.16	.96	.82	1.13	.95	.82	.76

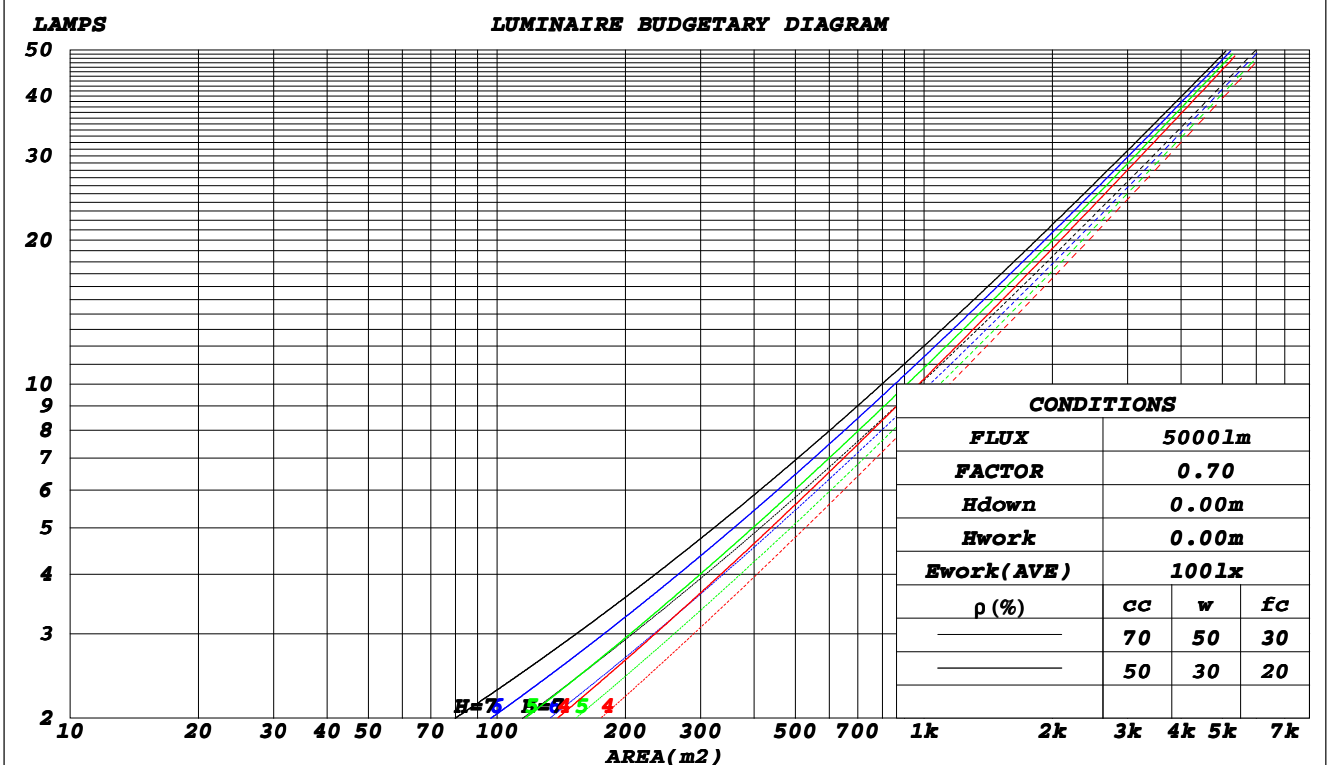

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature: 25DEG  
 Operators: DAMIN  
 Test Date: 2025-01-03

$\gamma$  Range: 0 - 180DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.269  
 Humidity: 65.0%  
 Test Distance: 7.000m [K=1.0000]  
 Remarks:

**WEC AND CCEC**

NAME:	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:
MFR.:	SUR.:	PROTECTION ANGLE:

$\rho_{cc}$	80%			70%			50%			30%			10%			0
$\rho_w$	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
$\rho_{fc}$	20%			20%			20%			20%			20%			0
<b>RCR</b>	<b>RCR:Room Cavity Ratio</b>						<b>Wall Exitance Coefficients(WEC)</b>									
0.0																
1.0	.895	.509	.161	.872	.497	.158	.828	.475	.152	.788	.454	.146	.751	.435	.140	
2.0	.863	.473	.145	.843	.464	.143	.804	.447	.139	.769	.431	.135	.736	.416	.131	
3.0	.810	.431	.129	.791	.424	.128	.757	.410	.125	.725	.397	.122	.696	.385	.119	
4.0	.754	.392	.115	.737	.386	.114	.707	.375	.112	.679	.364	.110	.652	.354	.108	
5.0	.701	.357	.103	.686	.352	.103	.659	.343	.101	.634	.334	.099	.610	.326	.098	
6.0	.653	.327	.094	.640	.323	.093	.615	.315	.092	.593	.308	.091	.571	.301	.089	
7.0	.609	.301	.085	.598	.298	.085	.576	.291	.084	.555	.285	.083	.536	.279	.082	
8.0	.570	.279	.078	.560	.276	.078	.540	.270	.077	.522	.264	.076	.504	.259	.075	
9.0	.535	.259	.072	.526	.256	.072	.508	.251	.071	.492	.246	.071	.476	.242	.070	
10.0	.504	.242	.067	.496	.239	.067	.480	.235	.066	.464	.231	.066	.450	.226	.065	

$\rho_{cc}$	80%			70%			50%			30%			10%			0
$\rho_w$	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	50%	30%	10%	0
$\rho_{fc}$	20%			20%			20%			20%			20%			0
<b>RCR</b>	<b>RCR:Room Cavity Ratio</b>						<b>Ceiling Cavity Exitance Coefficients(CCEC)</b>									
0.0	.630	.630	.630	.539	.539	.539	.368	.368	.368	.211	.211	.211	.068	.068	.068	
1.0	.594	.525	.462	.509	.450	.397	.348	.310	.275	.200	.179	.160	.064	.058	.052	
2.0	.568	.449	.349	.487	.387	.301	.334	.267	.210	.192	.156	.123	.062	.050	.040	
3.0	.545	.394	.274	.467	.340	.238	.320	.236	.167	.185	.138	.098	.059	.045	.032	
4.0	.521	.353	.223	.447	.305	.194	.308	.212	.137	.178	.124	.081	.057	.040	.027	
5.0	.499	.320	.188	.429	.277	.164	.295	.193	.116	.171	.114	.069	.055	.037	.023	
6.0	.478	.294	.163	.410	.255	.142	.283	.178	.100	.164	.105	.060	.053	.034	.020	
7.0	.457	.273	.144	.393	.236	.125	.272	.166	.089	.158	.098	.053	.051	.032	.017	
8.0	.437	.255	.129	.376	.221	.113	.260	.155	.080	.152	.092	.048	.049	.030	.016	
9.0	.419	.240	.118	.361	.208	.103	.250	.146	.073	.146	.086	.044	.047	.028	.014	
10.0	.402	.226	.110	.346	.196	.096	.240	.138	.068	.140	.082	.041	.045	.027	.013	

C Range: 0 - 360DEG  
 C Interval: 90.0DEG  
 Test Speed: HIGH  
 Temperature: 25DEG  
 Operators: DAMIN  
 Test Date: 2025-01-03

$\gamma$  Range: 0 - 180DEG  
 $\gamma$  Interval: 1.0DEG  
 Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.269  
 Humidity: 65.0%  
 Test Distance: 7.000m [K=1.0000]  
 Remarks:

**Uncorrected UGR Table**

NAME:		TYPE:					WEIGHT:				
DIM.:		SPEC.:					SERIAL No.:				
MFR.:		SUR.:					PROTECTION ANGLE:				
<b>ceiling/cavity</b>		<b>0.7</b>	<b>0.7</b>	<b>0.5</b>	<b>0.5</b>	<b>0.3</b>	<b>0.7</b>	<b>0.7</b>	<b>0.5</b>	<b>0.5</b>	<b>0.3</b>
<b>walls</b>		<b>0.5</b>	<b>0.3</b>	<b>0.5</b>	<b>0.3</b>	<b>0.3</b>	<b>0.5</b>	<b>0.3</b>	<b>0.5</b>	<b>0.3</b>	<b>0.3</b>
<b>working plane</b>		<b>0.2</b>	<b>0.2</b>	<b>0.2</b>	<b>0.2</b>	<b>0.2</b>	<b>0.2</b>	<b>0.2</b>	<b>0.2</b>	<b>0.2</b>	<b>0.2</b>
<b>Room dimensions</b>		<b>Viewed crosswise</b>					<b>Viewed endwise</b>				
<b>x = 2H y = 2H</b>		<b>30.9</b>	<b>32.4</b>	<b>31.2</b>	<b>32.6</b>	<b>32.8</b>	<b>30.3</b>	<b>31.8</b>	<b>30.6</b>	<b>32.0</b>	<b>32.3</b>
	<b>3H</b>	<b>32.2</b>	<b>33.5</b>	<b>32.5</b>	<b>33.8</b>	<b>34.1</b>	<b>31.3</b>	<b>32.6</b>	<b>31.6</b>	<b>32.9</b>	<b>33.1</b>
	<b>4H</b>	<b>32.5</b>	<b>33.8</b>	<b>32.9</b>	<b>34.1</b>	<b>34.4</b>	<b>31.4</b>	<b>32.7</b>	<b>31.8</b>	<b>33.0</b>	<b>33.3</b>
	<b>6H</b>	<b>32.7</b>	<b>33.9</b>	<b>33.0</b>	<b>34.2</b>	<b>34.5</b>	<b>31.4</b>	<b>32.6</b>	<b>31.8</b>	<b>32.9</b>	<b>33.2</b>
	<b>8H</b>	<b>32.6</b>	<b>33.8</b>	<b>33.0</b>	<b>34.1</b>	<b>34.4</b>	<b>31.4</b>	<b>32.5</b>	<b>31.7</b>	<b>32.8</b>	<b>33.1</b>
	<b>12H</b>	<b>32.6</b>	<b>33.7</b>	<b>33.0</b>	<b>34.0</b>	<b>34.4</b>	<b>31.3</b>	<b>32.4</b>	<b>31.7</b>	<b>32.7</b>	<b>33.1</b>
	<b>4H 2H</b>	<b>31.4</b>	<b>32.6</b>	<b>31.7</b>	<b>32.9</b>	<b>33.2</b>	<b>30.9</b>	<b>32.2</b>	<b>31.2</b>	<b>32.5</b>	<b>32.7</b>
	<b>3H</b>	<b>32.7</b>	<b>33.9</b>	<b>33.1</b>	<b>34.2</b>	<b>34.5</b>	<b>32.0</b>	<b>33.1</b>	<b>32.3</b>	<b>33.4</b>	<b>33.7</b>
	<b>4H</b>	<b>33.2</b>	<b>34.2</b>	<b>33.6</b>	<b>34.5</b>	<b>34.9</b>	<b>32.2</b>	<b>33.2</b>	<b>32.6</b>	<b>33.6</b>	<b>33.9</b>
	<b>6H</b>	<b>33.4</b>	<b>34.3</b>	<b>33.8</b>	<b>34.6</b>	<b>35.0</b>	<b>32.2</b>	<b>33.1</b>	<b>32.6</b>	<b>33.5</b>	<b>33.9</b>
	<b>8H</b>	<b>33.4</b>	<b>34.2</b>	<b>33.8</b>	<b>34.6</b>	<b>35.0</b>	<b>32.2</b>	<b>33.0</b>	<b>32.6</b>	<b>33.4</b>	<b>33.8</b>
	<b>12H</b>	<b>33.3</b>	<b>34.1</b>	<b>33.8</b>	<b>34.5</b>	<b>34.9</b>	<b>32.1</b>	<b>32.9</b>	<b>32.6</b>	<b>33.3</b>	<b>33.7</b>
	<b>8H 4H</b>	<b>33.2</b>	<b>34.1</b>	<b>33.7</b>	<b>34.4</b>	<b>34.9</b>	<b>32.3</b>	<b>33.1</b>	<b>32.7</b>	<b>33.5</b>	<b>34.0</b>
	<b>6H</b>	<b>33.4</b>	<b>34.1</b>	<b>33.9</b>	<b>34.6</b>	<b>35.0</b>	<b>32.3</b>	<b>33.0</b>	<b>32.8</b>	<b>33.5</b>	<b>33.9</b>
	<b>8H</b>	<b>33.5</b>	<b>34.1</b>	<b>33.9</b>	<b>34.5</b>	<b>35.0</b>	<b>32.3</b>	<b>32.9</b>	<b>32.8</b>	<b>33.4</b>	<b>33.9</b>
	<b>12H</b>	<b>33.4</b>	<b>34.0</b>	<b>33.9</b>	<b>34.4</b>	<b>34.9</b>	<b>32.3</b>	<b>32.8</b>	<b>32.8</b>	<b>33.3</b>	<b>33.8</b>
	<b>12H 4H</b>	<b>33.2</b>	<b>33.9</b>	<b>33.6</b>	<b>34.4</b>	<b>34.8</b>	<b>32.3</b>	<b>33.0</b>	<b>32.7</b>	<b>33.5</b>	<b>33.9</b>
	<b>6H</b>	<b>33.4</b>	<b>34.0</b>	<b>33.9</b>	<b>34.5</b>	<b>35.0</b>	<b>32.3</b>	<b>32.9</b>	<b>32.8</b>	<b>33.4</b>	<b>33.9</b>
	<b>8H</b>	<b>33.4</b>	<b>34.0</b>	<b>33.9</b>	<b>34.4</b>	<b>34.9</b>	<b>32.3</b>	<b>32.8</b>	<b>32.8</b>	<b>33.3</b>	<b>33.8</b>
<b>Variations with the observer position at spacings:</b>											
<b>S = 1.0H</b>		<b>+ 0.2 / - 0.3</b>					<b>+ 0.3 / - 0.4</b>				
<b>1.5H</b>		<b>+ 0.2 / - 0.4</b>					<b>+ 0.3 / - 0.6</b>				
<b>2.0H</b>		<b>+ 0.4 / - 0.5</b>					<b>+ 0.4 / - 0.6</b>				

CIE Pub.117 Corrected 17476 lm Total Lamp Luminous Flux.(8log(F/F0) = 9.9)

**C Range: 0 - 360DEG**  
**C Interval: 90.0DEG**  
**Test Speed: HIGH**  
**Temperature: 25DEG**  
**Operators: DAMIN**  
**Test Date: 2025-01-03**

**γ Range: 0 - 180DEG**  
**γ Interval: 1.0DEG**  
**Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.269**  
**Humidity: 65.0%**  
**Test Distance: 7.000m [K=1.0000]**  
**Remarks:**

**UTILIZATION FACTORS TABLE**

NAME:	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:
MFR.:	SUR.:	PROTECTION ANGLE:


REFLECTANCE										
Ceiling	0.8	0.8	0.8	0.7	0.7	0.7	0.5	0.5	0.5	0
Walls	0.7	0.5	0.3	0.7	0.5	0.3	0.7	0.5	0.3	0
Working plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0
<b>ROOM INDEX</b>	<b>UTILIZATION FACTORS(PERCENT) <math>k(RI) \times RCR = 5</math></b>									
<b>k = 0.60</b>	179	144	122	177	143	122	173	141	121	101
<b>0.80</b>	211	176	153	208	174	153	202	172	151	130
<b>1.00</b>	238	205	182	234	203	181	227	206	179	157
<b>1.25</b>	261	229	207	256	227	206	247	222	203	180
<b>1.50</b>	276	247	226	271	244	224	261	238	220	197
<b>2.00</b>	298	272	253	292	268	250	280	261	245	221
<b>2.50</b>	310	287	269	303	282	265	291	273	259	233
<b>3.00</b>	320	300	283	313	294	280	300	285	272	245
<b>4.00</b>	332	315	302	324	309	297	311	298	288	260
<b>5.00</b>	339	325	313	331	319	308	317	307	298	268
<b>ROOM INDEX</b>	<b>UF(total)</b>									<b>Direct</b>
<b>According to DIN EN 13032-2 2004</b>			<b>Suspended</b>				<b>SHRNOM = 1.25</b>			

**C Range: 0 - 360DEG**  
**C Interval: 90.0DEG**  
**Test Speed: HIGH**  
**Temperature: 25DEG**  
**Operators: DAMIN**  
**Test Date: 2025-01-03**

**$\gamma$  Range: 0 - 180DEG**  
 **$\gamma$  Interval: 1.0DEG**  
**Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.269**  
**Humidity: 65.0%**  
**Test Distance: 7.000m [K=1.0000]**  
**Remarks:**

**ISOCANDELA DIAGRAM**

NAME:	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:
MFR.:	SUR.:	PROTECTION ANGLE:

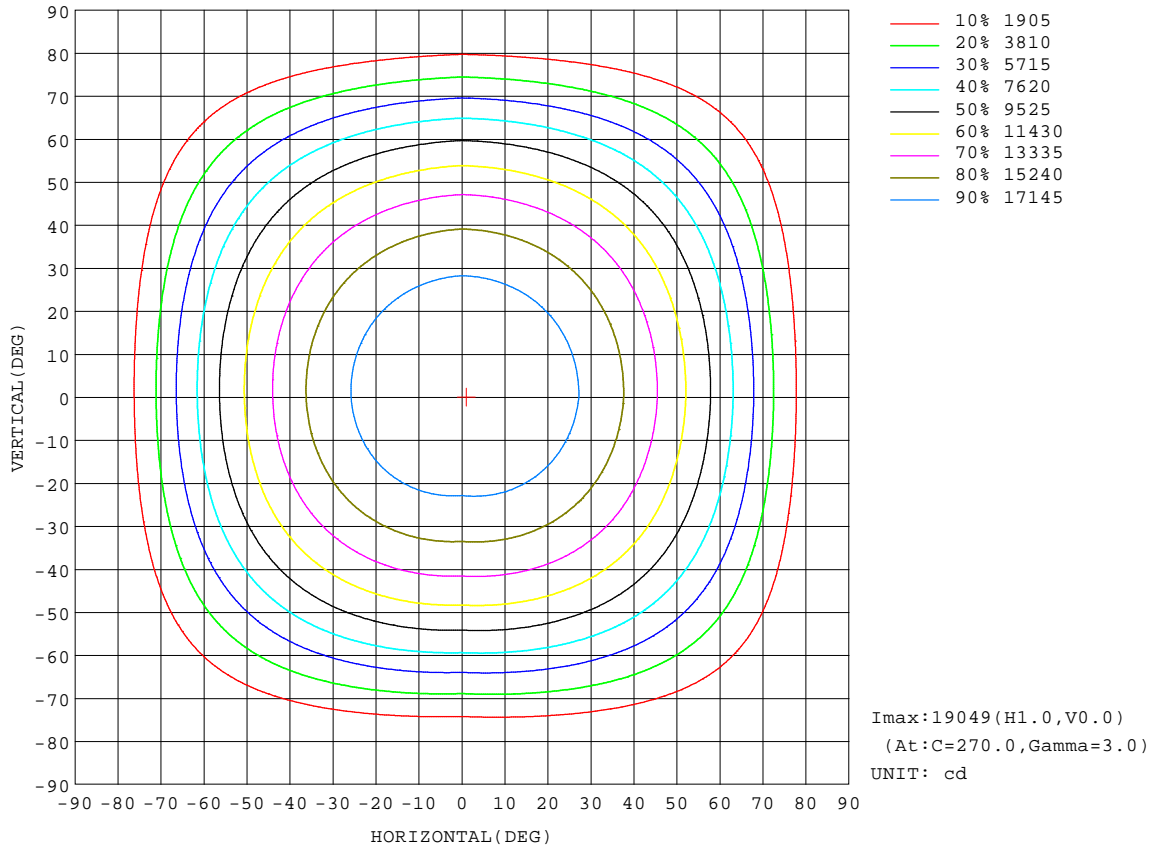


**C Range: 0 - 360DEG**  
**C Interval: 90.0DEG**  
**Test Speed: HIGH**  
**Temperature: 25DEG**  
**Operators: DAMIN**  
**Test Date: 2025-01-03**

**γ Range: 0 - 180DEG**  
**γ Interval: 1.0DEG**  
**Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.269**  
**Humidity: 65.0%**  
**Test Distance: 7.000m [K=1.0000]**  
**Remarks:**

**AAI Figure**

NAME:	TYPE:	WEIGHT:
DIM.:	SPEC.:	SERIAL No.:
MFR.:	SUR.:	PROTECTION ANGLE:

**Flux out:41423 lm**

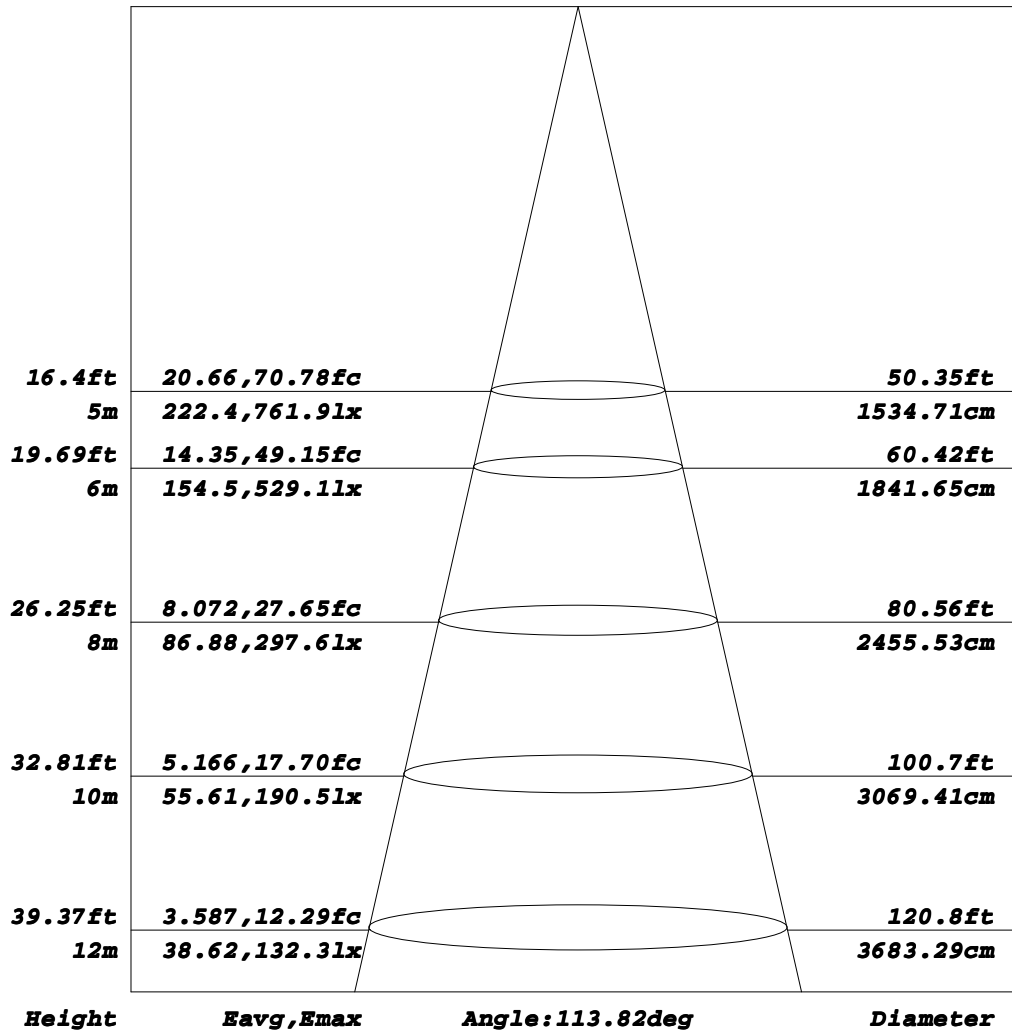


Note: The Curves indicate the illuminated area and the average illumination when the luminaire is at different distance.

**C Range: 0 - 360DEG**  
**C Interval: 90.0DEG**  
**Test Speed: HIGH**  
**Temperature: 25DEG**  
**Operators: DAMIN**  
**Test Date: 2025-01-03**

**γ Range: 0 - 180DEG**  
**γ Interval: 1.0DEG**  
**Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.269**  
**Humidity: 65.0%**  
**Test Distance: 7.000m [K=1.0000]**  
**Remarks:**

**ISOLUX DIAGRAM**


<b>NAME:</b>	<b>TYPE:</b>	<b>WEIGHT:</b>
<b>DIM.:</b>	<b>SPEC.:</b>	<b>SERIAL No.:</b>
<b>MFR.:</b>	<b>SUR.:</b>	<b>PROTECTION ANGLE:</b>

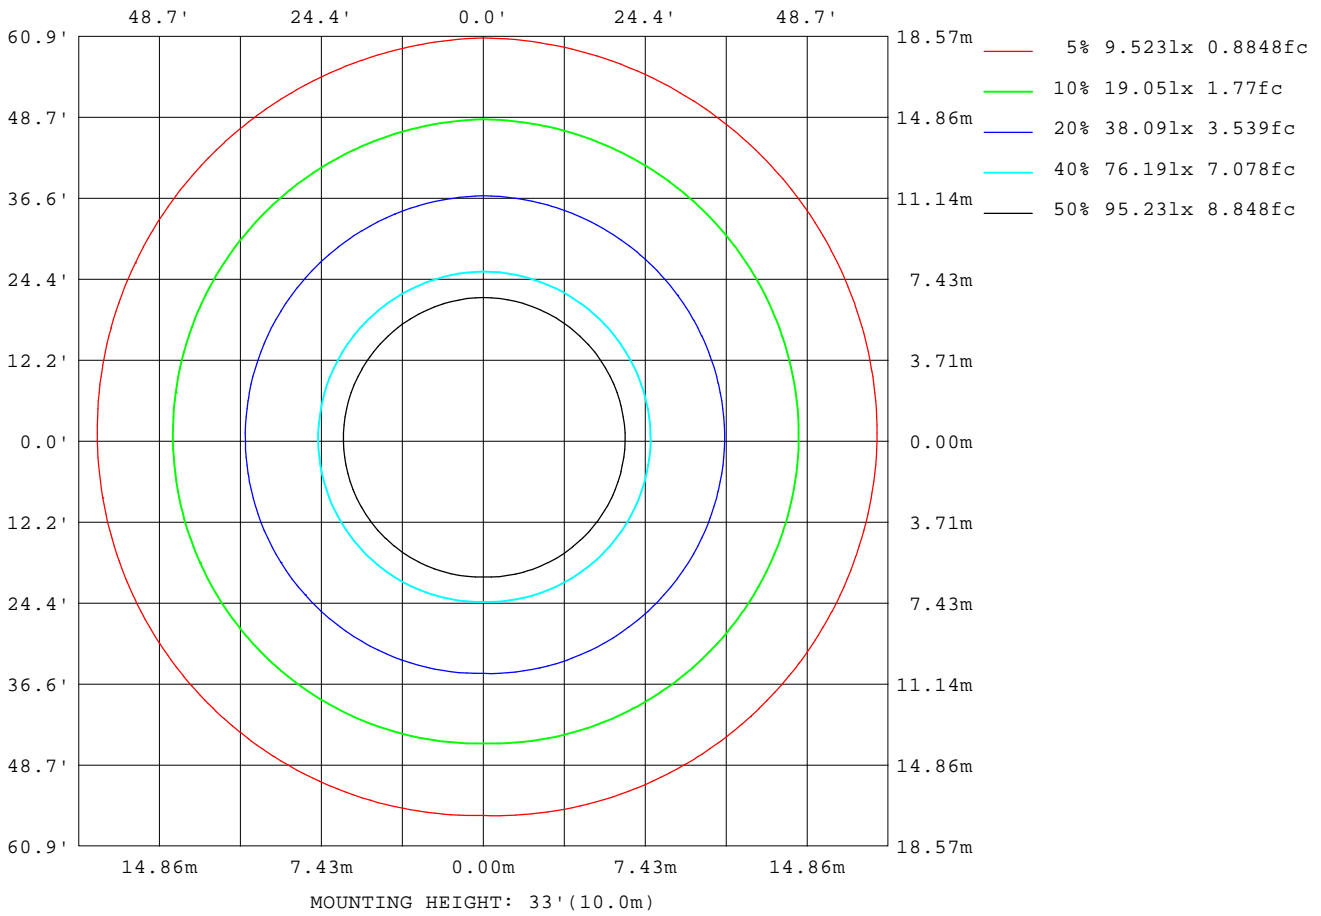

**C Range: 0 - 360DEG**  
**C Interval: 90.0DEG**  
**Test Speed: HIGH**  
**Temperature: 25DEG**  
**Operators: DAMIN**  
**Test Date: 2025-01-03**

**γ Range: 0 - 180DEG**  
**γ Interval: 1.0DEG**  
**Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.269**  
**Humidity: 65.0%**  
**Test Distance: 7.000m [K=1.0000]**  
**Remarks:**

**Planar Illuminance Curve**

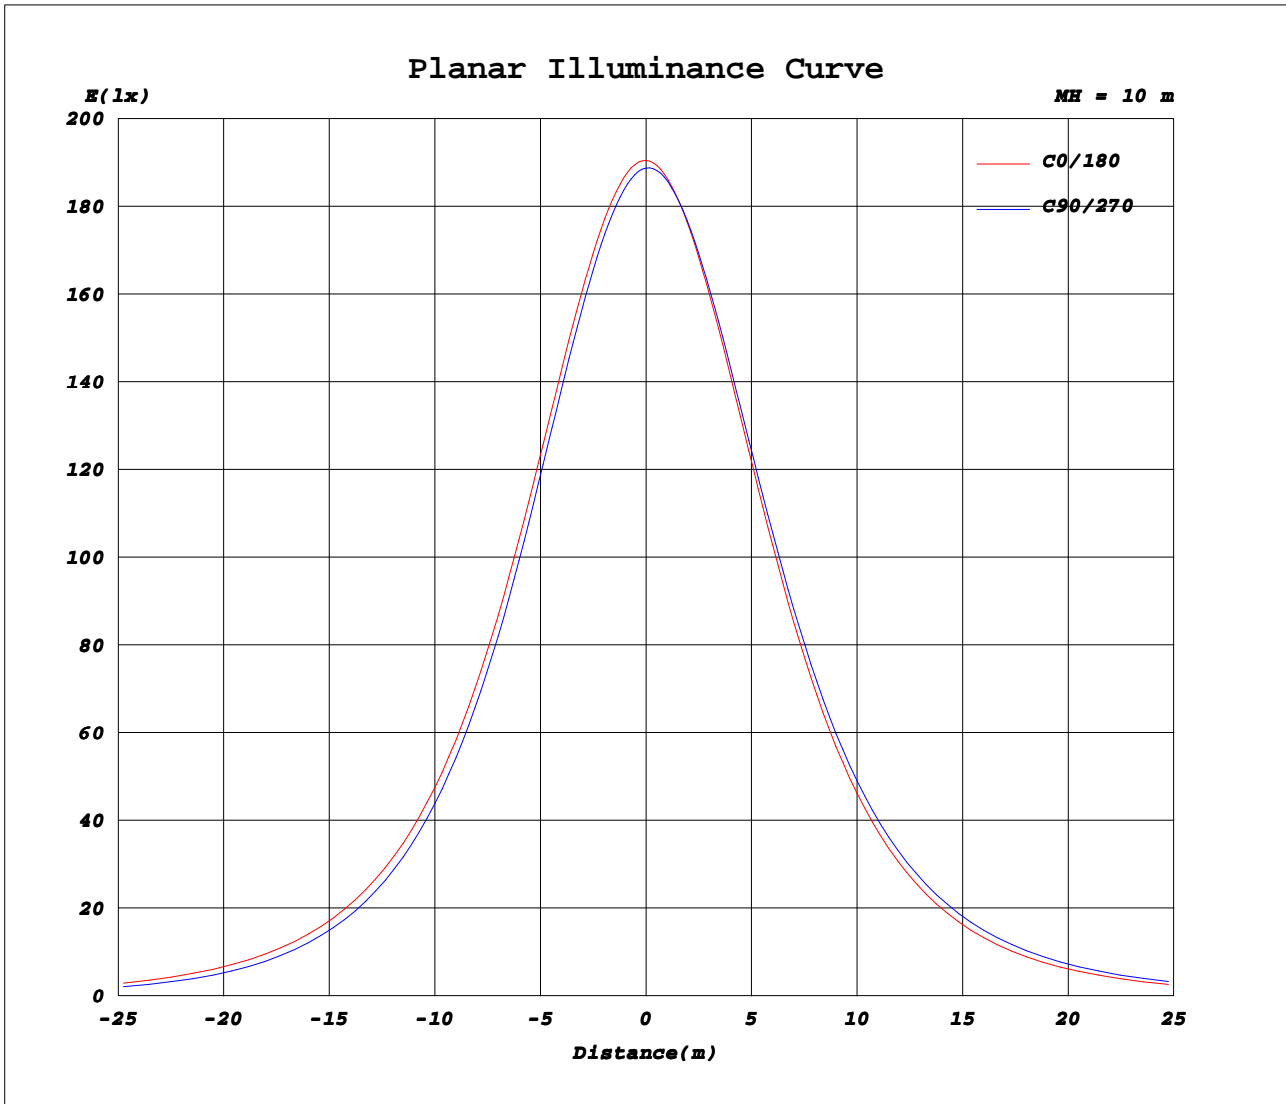

**C Range: 0 - 360DEG**  
**C Interval: 90.0DEG**  
**Test Speed: HIGH**  
**Temperature: 25DEG**  
**Operators: DAMIN**  
**Test Date: 2025-01-03**

**γ Range: 0 - 180DEG**  
**γ Interval: 1.0DEG**  
**Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.269**  
**Humidity: 65.0%**  
**Test Distance: 7.000m [K=1.0000]**  
**Remarks:**

**LUMINOUS DISTRIBUTION INTENSITY DATA**

<b>NAME:</b>	<b>TYPE:</b>	<b>WEIGHT:</b>
<b>DIM.:</b>	<b>SPEC.:</b>	<b>SERIAL No.:</b>
<b>MFR.:</b>	<b>SUR.:</b>	<b>PROTECTION ANGLE:</b>

Table--1

UNIT: ×10cd

C( DEG) γ (DEG)	0	90	180	270																
0	1896	1896	1896	1896																
5	1891	1881	1887	1897																
10	1871	1852	1864	1883																
15	1839	1812	1828	1856																
20	1795	1759	1780	1817																
25	1736	1692	1718	1764																
30	1664	1604	1640	1697																
35	1572	1500	1544	1613																
40	1463	1380	1430	1511																
45	1339	1247	1301	1393																
50	1200	1096	1157	1260																
55	1044	928	996	1111																
60	873	741	817	945																
65	685	531	626	759																
70	480	343	424	555																
75	285	164	236	361																
80	118	37.0	75.3	181																
85	16.4	6.21	7.80	45.3																
90	6.36	6.97	7.50	6.99																
95	7.26	7.98	8.51	7.72																
100	8.29	9.05	9.58	8.75																
105	9.38	10.2	10.7	9.84																
110	10.5	11.3	11.8	10.9																
115	11.6	12.3	12.9	12.0																
120	12.6	13.3	13.9	13.1																
125	13.6	14.4	14.9	14.1																
130	14.7	15.4	15.9	15.1																
135	15.7	16.5	17.0	16.1																
140	16.8	17.6	18.0	17.2																
145	18.0	18.8	19.1	18.3																
150	19.2	20.0	20.3	19.4																
155	20.5	21.2	21.4	20.6																
160	21.7	22.4	22.5	21.7																
165	22.8	23.3	23.4	22.8																
170	23.6	24.0	24.1	23.6																
175	24.2	24.5	24.5	24.2																
180	24.4	24.6	24.6	24.5																

**C Range: 0 - 360DEG**  
**C Interval: 90.0DEG**  
**Test Speed: HIGH**  
**Temperature: 25DEG**  
**Operators: DAMIN**  
**Test Date: 2025-01-03**

**γ Range: 0 - 180DEG**  
**γ Interval: 1.0DEG**  
**Test System: EVERFINE GO-2000B\_V1 SYSTEM V2.0.269**  
**Humidity: 65.0%**  
**Test Distance: 7.000m [K=1.0000]**  
**Remarks:**